

DESIGN PRINCIPLES

- Pervious paving is most suitable for low traffic areas – driveways, parking areas (maximum 1 - 2 vehicles per day per parking space), walkways, recreational vehicle pads, service roads, fire lanes.
- The ratio of impermeable surface area draining onto pervious pavement area should be 1.2:1 maximum.
- To avoid surface plugging, it is critical to protect pervious paving from sedimentation during and after construction.
- Identify pollutant sources, particularly in industrial/ commercial hotspots, that require pre-treatment or source control upstream.
- For designs which rely entirely on infiltration into underlying soils, the infiltration rate should be 12.5mm/hr minimum.
- Soil subgrade analysis should include soil texture class, moisture content, 96 hour soaked California Bearing Ratio (CBR) and on-site infiltration tests at the elevation of the base of the reservoir.
- Surface slope should be 1% minimum to avoid ponding and related sedimentation of fines.
- Wrap paver bedding material with geotextile filter cloth on bottom and sides to maintain water quality performance and keep out intrusion of fines.
- Provide edge restraint to contain pavers, similar to standard unit paving.
- Design reservoir water levels using continuous flow modelling. Drawdown time - 96 hrs max., 72 hrs desirable.
- Bottom of reservoir: flat in full infiltration designs, minimum 0.1% slope to drain in piped systems.
- Where utility trenches must be constructed below the reservoir, install trench dams at exits to avoid infiltration water following the utility trench.
- Pavers with wide joints should not be used for disabled persons parking or pedestrian ramps at street crossings.
- If being designed for heavy loads, optional reinforcing grids may be included in the pavement subbase.




Pervious paving is a surface layer that allows rainfall to percolate into an underlying reservoir base where rainfall is either infiltrated to underlying soils or removed by a subsurface drain. The surface component of pervious paving can be:

- Porous asphalt or porous concrete.
- Concrete or plastic grid structures filled with unvegetated gravel or vegetated soil,
- Concrete modular pavers with gapped joints that allow water to percolate through.


Pervious pavement designs may be one of three types:

- Full infiltration.
- Partial infiltration.
- Partial infiltration with flow restrictor.

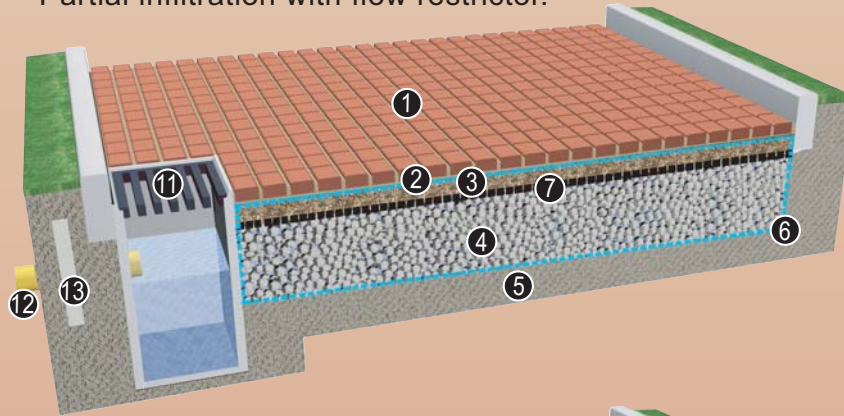


Full Infiltration

Where rainfall is intended to infiltrate into the underlying subsoil. Candidate in sites with subsoil permeability > 15mm/hr.

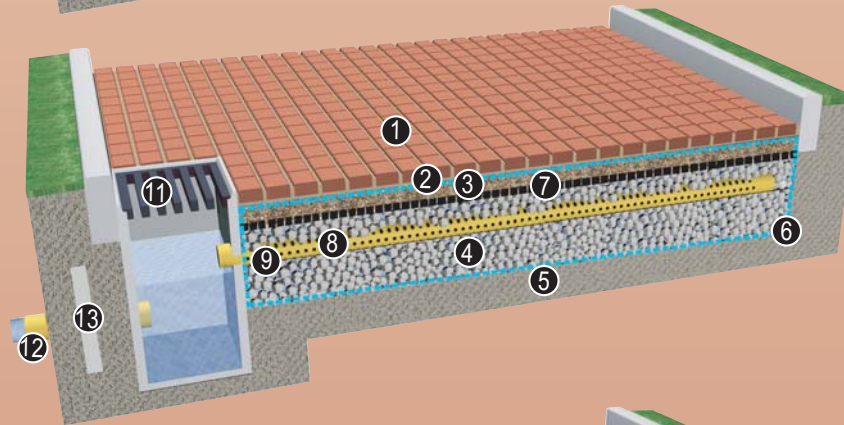

Partial Infiltration

Designed so that most water may infiltrate into the underlying soil while the surplus overflow is drained by perforated pipes that are placed near the top of the drain rock reservoir. Suitable for subsoil permeability >1 and < 15mm/hr.

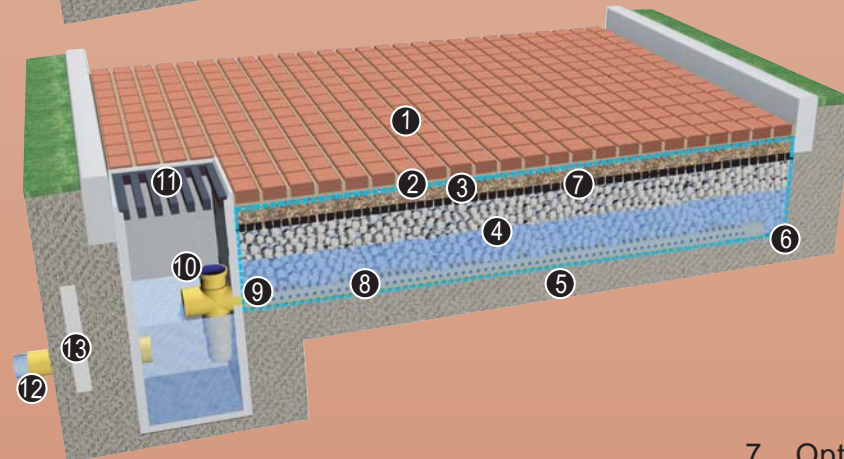

Partial Infiltration with Flow Restrictor

Where subsoil permeability is < 1mm/hr, water is removed at a controlled rate through a bottom pipe system and flow restrictor assembly. Systems are essentially underground detention systems, used where the underlying soil has very low permeability or in areas with high water table. Also provides water quality benefits.

1. Permeable Pavers (Min. 80mm thickness)
2. Aggregate Bedding Course - not sand (50mm depth)
3. Open Graded Base (depth varies by design application)
4. Open Graded Sub-base (depth varies by design application)
5. Subsoil - flat and scarified in infiltration designs
6. Geotextile on All Sides of Reservoir
7. Optional Reinforcing Grid for Heavy Loads
8. Perforated Drain Pipe 150mm Dia. Min.
9. Geotextile Adhered to Drain at Opening
10. Flow Restrictor Assembly
11. Secondary Overflow Inlet at Catch Basin
12. Outlet Pipe to Storm Drain or Swale System. Locate Crown of Pipe Below Open Graded Base (no. 3) to Prevent Heaving During Freeze/Thaw Cycle
13. Trench Dams at All Utility Crossings

Pervious Paving



Greater
Vancouver
Regional
District

Stormwater Source Control Design Guidelines 2005



Goya Ngan
Landscape Architect

Detailed design guidelines can be found in the Design Guidelines 2005 report, available at www.gvrd.bc.ca